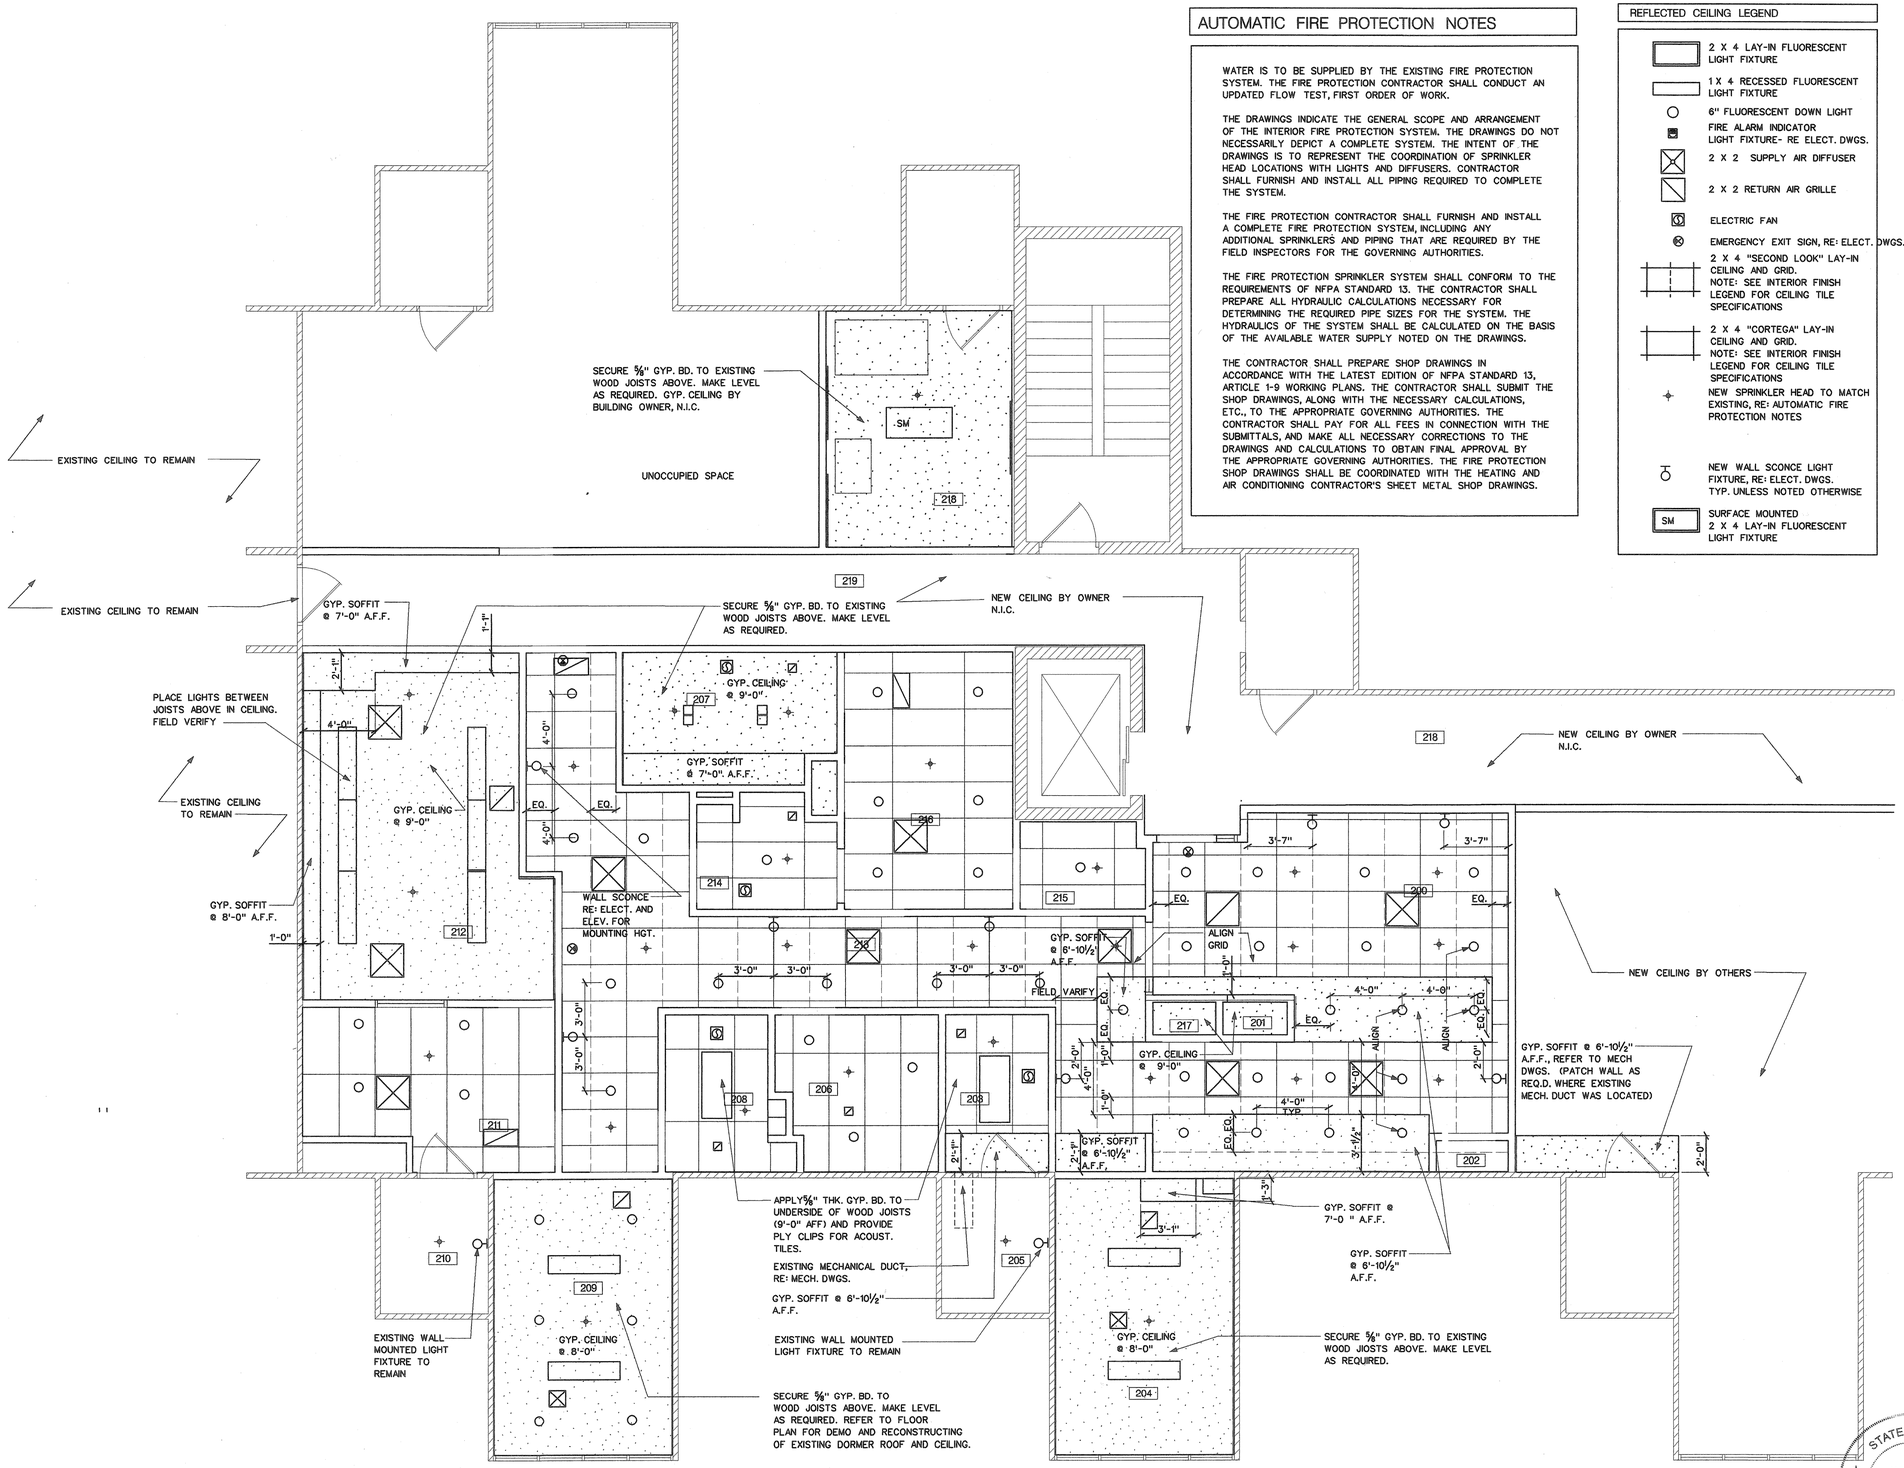

AUTOMATIC FIRE PROTECTION NOTES

WATER IS TO BE SUPPLIED BY THE EXISTING FIRE PROTECTION SYSTEM. THE FIRE PROTECTION CONTRACTOR SHALL CONDUCT AN UPDATED FLOW TEST, FIRST ORDER OF WORK.

THE DRAWINGS INDICATE THE GENERAL SCOPE AND ARRANGEMENT OF THE INTERIOR FIRE PROTECTION SYSTEM. THE DRAWINGS DO NOT NECESSARILY DEPICT A COMPLETE SYSTEM. THE INTENT OF THE DRAWINGS IS TO REPRESENT THE COORDINATION OF SPRINKLER HEAD LOCATIONS WITH LIGHTS AND DIFFUSERS. CONTRACTOR SHALL FURNISH AND INSTALL ALL PIPING REQUIRED TO COMPLETE THE SYSTEM.

THE FIRE PROTECTION CONTRACTOR SHALL FURNISH AND INSTALL A COMPLETE FIRE PROTECTION SYSTEM, INCLUDING ANY ADDITIONAL SPRINKLERS AND PIPING THAT ARE REQUIRED BY THE FIELD INSPECTORS FOR THE GOVERNING AUTHORITIES.

THE FIRE PROTECTION SPRINKLER SYSTEM SHALL CONFORM TO THE REQUIREMENTS OF NFPA STANDARD 13. THE CONTRACTOR SHALL PREPARE ALL HYDRAULIC CALCULATIONS NECESSARY FOR DETERMINING THE REQUIRED PIPE SIZES FOR THE SYSTEM. THE HYDRAULICS OF THE SYSTEM SHALL BE CALCULATED ON THE BASIS OF THE AVAILABLE WATER SUPPLY NOTED ON THE DRAWINGS.

THE CONTRACTOR SHALL PREPARE SHOP DRAWINGS IN ACCORDANCE WITH THE LATEST EDITION OF NFPA STANDARD 13, ARTICLE 1-9 WORKING PLANS. THE CONTRACTOR SHALL SUBMIT THE SHOP DRAWINGS, ALONG WITH THE NECESSARY CALCULATIONS, ETC., TO THE APPROPRIATE GOVERNING AUTHORITIES. THE CONTRACTOR SHALL PAY FOR ALL FEES IN CONNECTION WITH THE SUBMITTALS, AND MAKE ALL NECESSARY CORRECTIONS TO THE DRAWINGS AND CALCULATIONS TO OBTAIN FINAL APPROVAL BY THE APPROPRIATE GOVERNING AUTHORITIES. THE FIRE PROTECTION SHOP DRAWINGS SHALL BE COORDINATED WITH THE HEATING AND AIR CONDITIONING CONTRACTOR'S SHEET METAL SHOP DRAWINGS.

REFLECTED CEILING LEGEND

- 2 X 4 LAY-IN FLUORESCENT LIGHT FIXTURE
- 1 X 4 RECESSED FLUORESCENT LIGHT FIXTURE
- 6" FLUORESCENT DOWN LIGHT
- FIRE ALARM INDICATOR LIGHT FIXTURE- RE ELECT. DWGS.
- 2 X 2 SUPPLY AIR DIFFUSER
- 2 X 2 RETURN AIR GRILLE
- ELECTRIC FAN
- EMERGENCY EXIT SIGN, RE: ELECT. DWGS.
- 2 X 4 "SECOND LOOK" LAY-IN CEILING AND GRID. NOTE: SEE INTERIOR FINISH LEGEND FOR CEILING TILE SPECIFICATIONS
- 2 X 4 "CORTEGA" LAY-IN CEILING AND GRID. NOTE: SEE INTERIOR FINISH LEGEND FOR CEILING TILE SPECIFICATIONS
- NEW SPRINKLER HEAD TO MATCH EXISTING, RE: AUTOMATIC FIRE PROTECTION NOTES
- NEW WALL SCONCE LIGHT FIXTURE, RE: ELECT. DWGS. TYP. UNLESS NOTED OTHERWISE
- SM — SURFACE MOUNTED 2 X 4 LAY-IN FLUORESCENT LIGHT FIXTURE

William Andrews Architects

Architecture • Interior Design • Construction Services

6631 Commerce Parkway, Studio B
Dublin, Ohio 43017

Phone: 614-766-1117
Fax: 614-766-2023

E-mail: WAarch@aol.com

All drawings and written material appearing herein constitute the original and unpublished work of the Architect and may not be duplicated, used, or disclosed without the prior written consent of the Architect.
© 1997 William Andrews Architects

GENERAL R.C.P. NOTES

1. CEILING HEIGHTS TO BE 8'-0" A.F.F. TYP., UNLESS NOTED OTHERWISE
2. REFER TO ELECTRICAL, MECHANICAL AND PLUMBING DIAGRAMS FOR ADDITIONAL INFORMATION.
3. REFER TO AUTOMATIC FIRE PROTECTION NOTES FOR ADDITIONAL INFORMATION.

JASONWAY IMAGING CENTER

FEB. 6th, 1998 PROJ. No. : 97045

- ☐ SCHEMATIC DESIGN
- ☐ DESIGN DEVELOPMENT
- ☐ DESIGN DEV. SIGN-OFF
- ☐ BIDDING
- ☐ BLDG. PERMIT SUBMISSION
- ■ CONSTRUCTION
- ☐ NOT FOR CONSTRUCTION
- ☐ RECORD / FILE

- △1 REVISION No. 1
- △2 REVISION No. 2
- △3 REVISION No. 3
- △4 REVISION No. 4
- △5 REVISION No. 5
- △6 REVISION No. 6

REFLECTED CEILING PLAN

STATE OF OHIO
WILLIAM G. ANDREWS
6280
REGISTERED ARCHITECT

A-02