


This drawing and the material appearing herein, constitute the original and unpublished work of Feinknopf Macioce Schappa Architects, Inc. and may not be used on any project for any purpose, nor may the same be copied (except by those governmental agencies required by law), or disclosed without written consent of the architect.

© COPYRIGHT FEINKNOPF MACIOCE SCHAPPA, ARCHITECTS, INC.

HVAC UNIT SCHEDULE

UNIT NO.	INDOOR GAS-FIRED FURNACE (AHU)								COOLING COIL				OUTDOOR CONDENSING UNIT (CU)							REMARKS		
	MFR. MODEL NO.	CFM	E.S.P.	H.P.	RPM	HEAT INPUT MBH	HEAT OUTPUT MBH	FILTERS	VOLTS	MFR. MODEL NO.	FACE AREA	AIR P.D.	ROWS	MFR. MODEL NO.	TOTAL COOLING CAPACITY M.B.H.	SENSIBLE COOLING CAPACITY M.B.H.	WATTS	FULL LOAD AMPS	REC. MAX. FUSE (AMPS)		VOLTS	E.E.R.
AHU-1 CU-1																						EXISTING UNIT IN RM 107.
AHU-2 CU-2	GHR26Q4/5-100	1995	.50	3/4	1750	100	93	20"x25"x1"	120	CR26-65N	6.42	0.39	3	HS25-653	57.0	40.5	5140	19	40	208	10.7	MIN. 600 CFM O.A. DOWNFLOW CONFIGURATION
AHU-3 CU-3	G26Q3-50	900	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.0	0.24	2	HS25-311	33.3	25.0	2785	14.6	30	208	11.5	MIN. 240 CFM O.A. UPFLOW CONFIGURATION
AHU-4 CU-4	GHR26Q3/4-100	1600	.50	1/2	1750	100	92	20"x25"x1"	120	CR26-65N	6.42	0.26	3	HS25-513	46.7	32.7	4190	15.2	30	208	10.5	MIN. 320 CFM O.A. DOWNFLOW CONFIGURATION
AHU-5 CU-5	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 300 CFM O.A. DOWNFLOW CONFIGURATION
AHU-6 CU-6	GHR26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-21	3.21	.05	2	HS25-211	19.7	14.1	1865	10.8	20	208	10.2	MIN. 180 CFM O.A. DOWNFLOW CONFIGURATION
AHU-7 CU-7	GHR26Q3-50	1000	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-31	3.21	0.25	3	HS25-311	31.2	22.8	2590	14.6	30	208	11.2	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-8 CU-8	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-9 CU-9	GHR26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-31	3.21	0.25	3	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 160 CFM O.A. DOWNFLOW CONFIGURATION
AHU-10 CU-10	G26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.00	0.16	2	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 160 CFM O.A. UPFLOW CONFIGURATION
AHU-11 CU-11	G26Q3-75	1200	.50	1/3	1750	75	70	14"x25"x1"	120	C26-41	4.44	0.21	3	HS25-413	37.5	28.1	3200	11.4	20	208	11.0	MIN. 360 CFM O.A. UPFLOW CONFIGURATION
AHU-12 CU-12	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-13 CU-13	G26Q3-75	1200	.50	1/3	1750	75	70	14"x25"x1"	120	C26-41	4.44	0.21	3	HS25-413	37.5	28.1	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. UPFLOW CONFIGURATION
AHU-14 CU-14	G26Q4/5-75	1400	.50	3/4	1750	75	70	20"x25"x1"	120	C26-51	6.42	0.18	3	HS25-463	44.3	33.7	3960	13.6	25	208	10.8	MIN. 280 CFM O.A. UPFLOW CONFIGURATION
AHU-15 CU-15	G26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.00	0.16	2	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 160 CFM O.A. UPFLOW CONFIGURATION
AHU-16 CU-16	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-17 CU-17	GHR26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-21	3.21	.05	2	HS25-211	19.8	15.6	1865	10.8	20	208	10.2	MIN. 120 CFM O.A. DOWNFLOW CONFIGURATION
AHU-18 CU-18	GHR26Q3-75	1200	.50	1/3	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-19 CU-19	G26Q3-50	1000	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.00	0.24	3	HS25-311	36.2	25.7	2785	14.6	30	208	11.2	MIN. 200 CFM O.A. UPFLOW CONFIGURATION
AHU-20 CU-20	GHR26Q4/5-100	1995	.50	3/4	1750	100	93	20"x25"x1"	120	CR26-65N	6.42	0.39	3	HS25-653	57.0	40.5	5140	19	40	208	10.7	MIN. 600 CFM O.A. DOWNFLOW CONFIGURATION
AHU-21 CU-21	GHR26Q3/4-100	1600	.50	1/2	1750	100	92	20"x25"x1"	120	CR26-65N	6.42	0.26	3	HS25-513	46.7	32.7	4190	15.2	30	208	10.5	MIN. 320 CFM O.A. DOWNFLOW CONFIGURATION
AHU-22 CU-22	G26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.00	0.24	3	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 240 CFM O.A. UPFLOW CONFIGURATION
AHU-23 CU-23	G26Q3-50	1000	.50	1/3	1750	50	47	14"x25"x1"	120	C26-31	4.00	0.24	3	HS25-311	31.2	22.8	2590	14.6	30	208	11.2	MIN. 200 CFM O.A. UPFLOW CONFIGURATION
AHU-24 CU-24	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.24	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 240 CFM O.A. DOWNFLOW CONFIGURATION
AHU-25 CU-25	GHR26Q3-50	600	.50	1/3	1750	50	47	24"x25"x1"	120	CR26-21	3.21	.05	2	HS25-211	19.8	15.6	1865	10.8	20	208	10.2	MIN. 120 CFM O.A. DOWNFLOW CONFIGURATION
AHU-26 CU-26	GHR26Q3-75	1200	.50	1/2	1750	75	70	14"x25"x1"	120	CR26-41W	4.08	0.21	3	HS25-413	36.9	27.7	3200	11.4	20	208	11.0	MIN. 300 CFM O.A. DOWNFLOW CONFIGURATION
AHU-27 CU-27	GHR26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-31	3.21	0.25	3	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 160 CFM O.A. DOWNFLOW CONFIGURATION
AHU-28 CU-28	GHR26Q3-50	800	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-31	3.21	0.25	3	HS25-261	24.8	18.1	2590	12.7	25	208	11.5	MIN. 160 CFM O.A. DOWNFLOW CONFIGURATION
AHU-29 CU-29	GHR26Q3-50	600	.50	1/3	1750	50	47	14"x25"x1"	120	CR26-21	3.21	.05	2	HS25-211	19.8	15.6	1865	10.8	20	208	10.2	MIN. 120 CFM O.A. DOWNFLOW CONFIGURATION
AHU-30 CU-30	GHR26Q3/4-100	1400	.50	1/2	1750	100	92	20"x25"x1"	120	CR26-51N	5.25	0.22	3	HS25-463	41.7	30.4	3705	13.6	25	208	10.8	MIN. 280 CFM O.A. DOWNFLOW CONFIGURATION

① BASED ON LENNOX PULSE UNLESS OTHERWISE NOTED.
② BASED ON AMERICAN AIR FILTER.

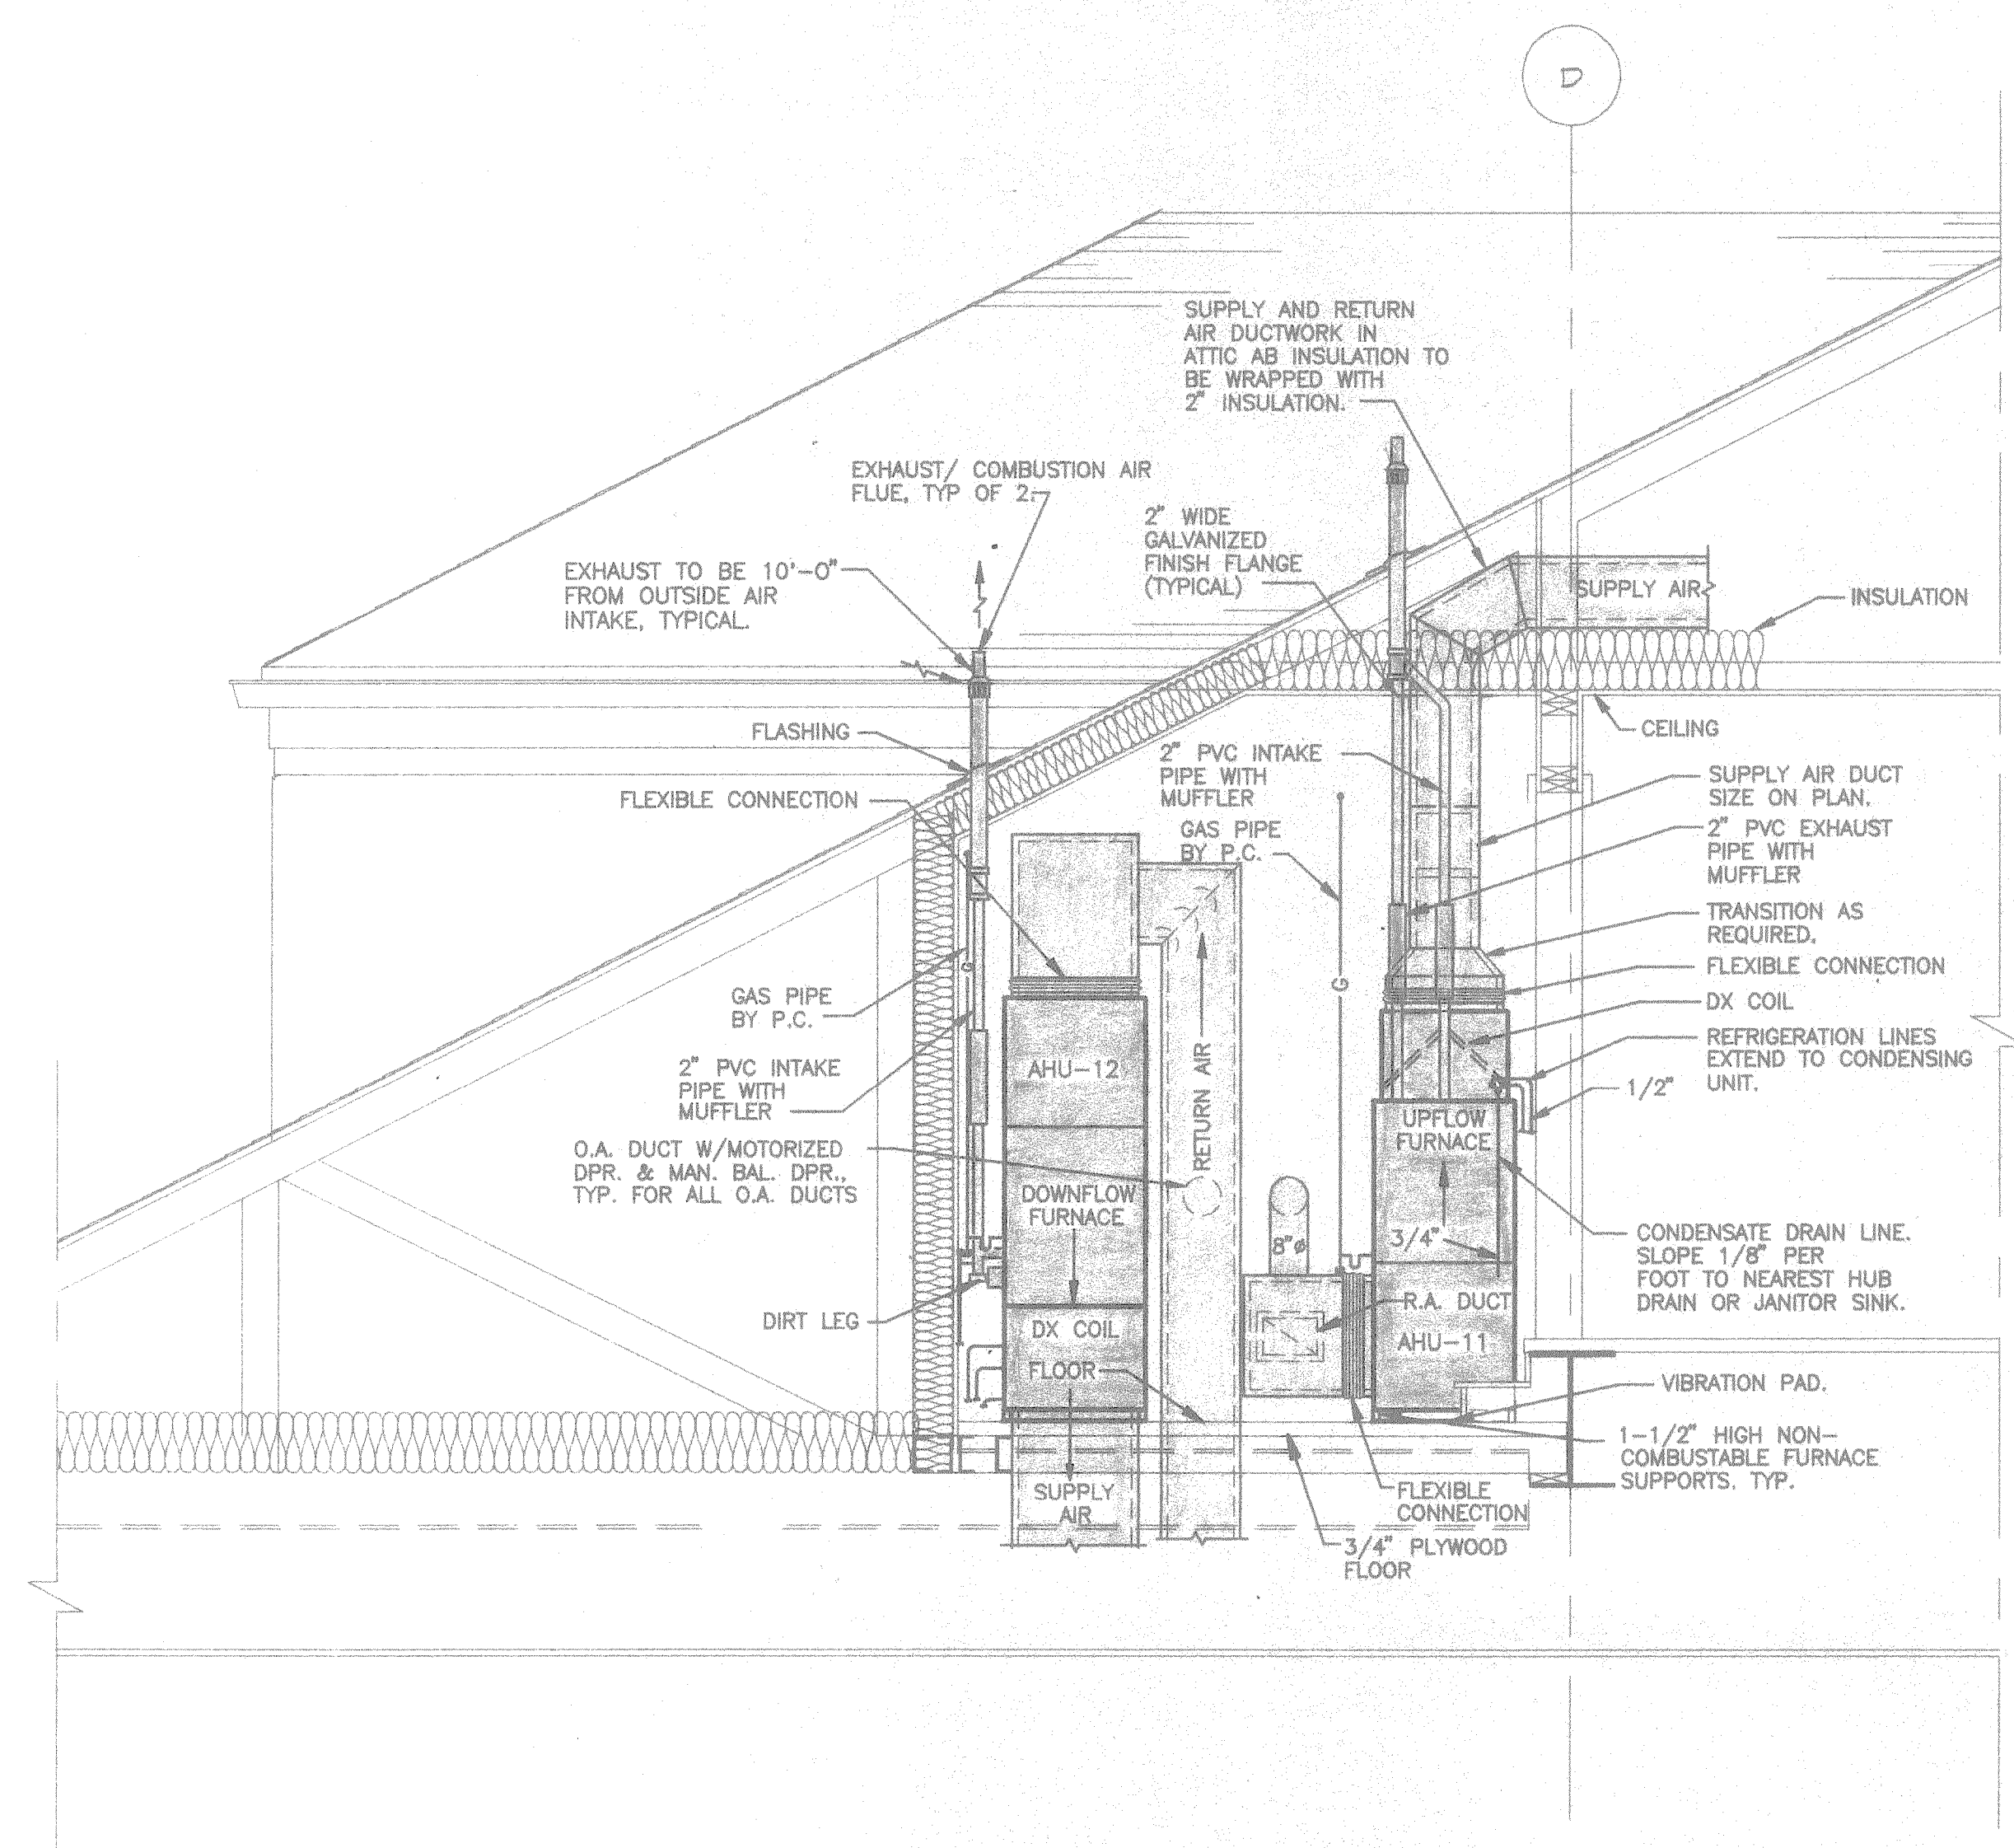

SECTION A H3
1/2" = 1'-0"

EXHAUST FAN SCHEDULE

UNIT NO.	MFR. MODEL NO.	TYPE	C.F.M.	S.P. IN. W.G.	WHEEL R.P.M.	MOTOR			SERVING	LOCATION	REMARKS	
						H.P. WATTS	RPM	VOLTS PHASE				
EF-1	LITTLE GEM II	CLG	100	0.25	1200	60	1200	120	1	RESTROOMS	VARIOUS RESTROOMS	FURNISH UNIT W/ BACKDRAFT DAMPER, AND GRILLE RUN EXH. DUCT TO ALUMINUM ROOF CAP TYPE PR8 W/ SLOPED ROOF CURB. SWITCH FAN W/ LIGHTS.

① BASED ON LOREN COOK UNLESS OTHERWISE NOTED.

VENTILATOR SCHEDULE

UNIT NO.	MFR. MODEL NO.	SERVICE	MAX C.F.M.	MAX. AIR P.D., IN. W.G.	THROAT SIZE, IN.	HOOD SIZE, IN.	SERVING	LOCATION	REMARKS
EV-1	PR8	EXHAUST	200	0.3	8.5"	18.25"	EF-2	ROOF	FURNISH VENTILATORS W/ BIRDSCREEN AND CURB.

① BASED ON LOREN COOK UNLESS OTHERWISE NOTED.


ELECTRIC WALL HEATER

UNIT NO.	MFR. MODEL NO.	KW INPUT	C.F.M.	BTU, HR.	UNIT AMPS	MOTOR			LOCATION	REMARKS	
						H.P. WATTS	RPM	VOLTS PHASE			
EWH-1	QMARK AWH-340B	2.0	100	6842	10.0	---	---	208	1	VARIOUS 1st FLOOR VESTIBULES	FURNISH UNIT W/ INTEGRAL THERMOSTAT, THERMAL OVERHEAT PROTECTION, AND POWER DISCONNECT.

FEINKNOPF MACIOCE SCHAPPA Architects, Inc.

274 Marconi Boulevard, Columbus, Ohio 43215
tele (614) 221-3192 fax (614) 221-5601

Proposed Office for
Columbus Oncology Associates, Inc.
& Central Ohio Internal Medicine
810 Jasonway Avenue
Columbus, Ohio

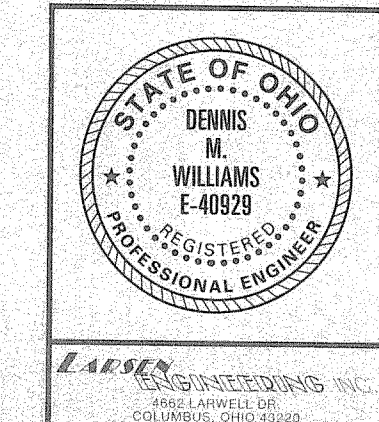

DETAILS H-4