


PARTIAL FIRST FLOOR HVAC PLAN

SCALE: 3/16" = 1' - 0"

SMC
 STALEY MECHANICAL
 CONSULTING, INC.
 302 S. CHAPEL STREET
 LOUISVILLE, OHIO 46041
 (513) 457-7244 F. (513) 457-7245
 © COPYRIGHT 2007

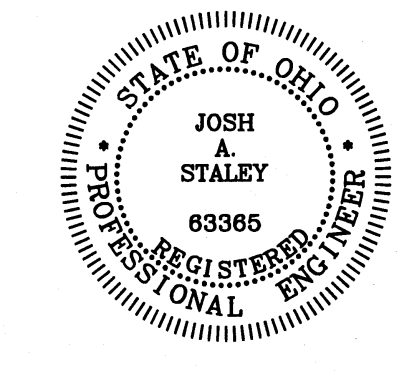

GENERAL NOTES


- 1 SEE ARCHITECTURAL DETAILS FOR EXACT LOCATIONS AND DIMENSIONS OF EQUIPMENT, FIXTURES, OPENINGS AND OUTLETS. COMMUNICATE WITH ARCHITECT ANY DISCREPANCIES.
- 2 THIS CONTRACTOR TO PROVIDE ALL OPENINGS IN EXISTING STRUCTURE AS REQUIRED FOR NEW WORK INCLUDING FLASHINGS AND REPAIRS FOR ROOF OPENINGS AND CAULKING AND SEALING FOR WALL OPENINGS LEAVING A WEATHER-PROOF CONDITION.
- 3 THIS CONTRACTOR TO PATCH ANY UNUSED OPENINGS LEFT FROM DEMOLITION WORK LEAVING A LIKE NEW CONDITION. SEAL ANY ROOF OR WALL OPENINGS WEATHER-PROOF.
- 4 COORDINATE ALL INSTALLATIONS OF MATERIAL AND EQUIPMENT WHICH IS EXPOSED TO VIEW INSIDE AND OUTSIDE OF STRUCTURE WITH OWNER AND ARCHITECT BEFORE PURCHASE. ALL MUST BE REVIEWED AND APPROVED BEFOREHAND.
- 5 THIS CONTRACTOR IS TO COORDINATE ELECTRICAL CHARACTERISTICS OF EQUIPMENT WITH ELECTRICAL CONTRACTOR BEFORE ORDERING ANY EQUIPMENT.

CODED NOTES

- 1 CAP EXISTING DUCT BRANCH AT MAIN OR END OF DUCT MAIN WITH SHEET METAL PATCH OR CAP AND SEAL AIR TIGHT.
- 2 CONNECT TO EXISTING DUCT AND EXTEND TO AIR DEVICE OR BRANCH MAIN AS INDICATED.
- 3 EXISTING RELOCATED THERMOSTAT. EXTEND WIRING AS REQUIRED.
- 4 EXISTING RELOCATED EXHAUST FAN. EXTEND 6" DUCT TO RELIEF VENTILATOR AS INDICATED.
- 5 EXISTING WALL HEATER.
- 6 VACUUM CLEAN INSIDE OF EXISTING FURNACE AND REPLACE FILTERS AFTER CONSTRUCTION IS COMPLETE.
- 7 BALANCE OUTSIDE AIR DAMPERS TO EXISTING FURNACES TO VALUES INDICATED ON OUTSIDE AIR SCHEDULE.
- 8 SECURE CONDENSING UNIT TO 6" HIGH CONCRETE PAD. SIZE AND INSTALL REFRIGERATION PIPE PER MANUFACTURERS INSTRUCTIONS.
- 9 ROOM SENSOR TO PROVIDE SIGNAL TO AVERAGING TEMPERATURE CONTROLLER. PROVIDE ALL WIRING FOR A COMPLETE WORKING SYSTEM.
- 10 NEW THERMOSTAT FOR FURNACE CAPABLE OF AVERAGING THE READINGS FROM REMOTE SENSORS.

revisions

3660 embassy parkway
 akron, ohio 44333
 tel. 330.666.5770
 fax. 330.666.8812
 web site www.mam-architects.com

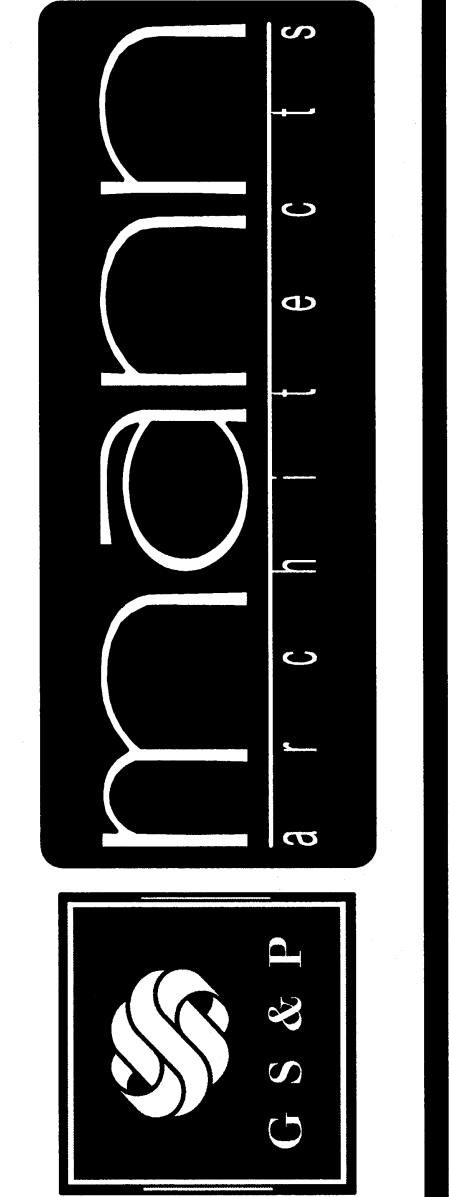

drawing
 HVAC PLANS
 project no. 11406
 date OCTOBER 23, 2007
 scale AS NOTED
 project COLUMBUS ONCOLOGY
 JASONIAT PROFESSIONAL BUILDING
 810 JASONIAT AVENUE, SUITE A
 COLUMBUS, OHIO 43214-2329

